




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Clamp Ceiling 60/80		
Size [mm]:	w = 600	h = 600	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.02
125	0.09
250	0.19
500	0.45
1000	0.52
2000	0.54
4000	0.61
N₁₀ = 22.2	

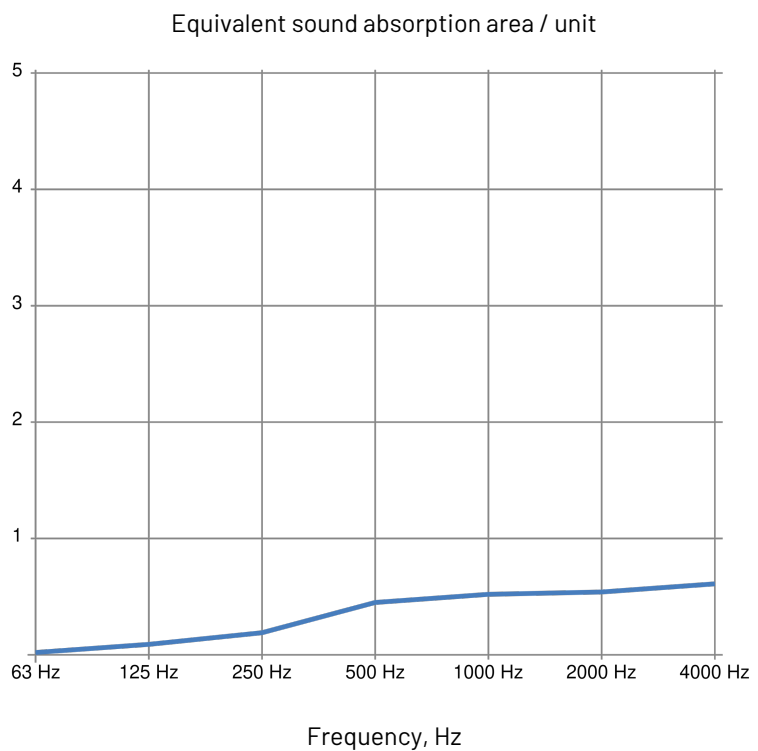

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M19	2021-10-29






SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Clamp Floor		
Size [mm]:	w = 1200	h = 1630	d = 45

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.49
125	0.78
250	1.6
500	2.7
1000	3.5
2000	3.4
4000	3.6
N₁₀ = 3.7	

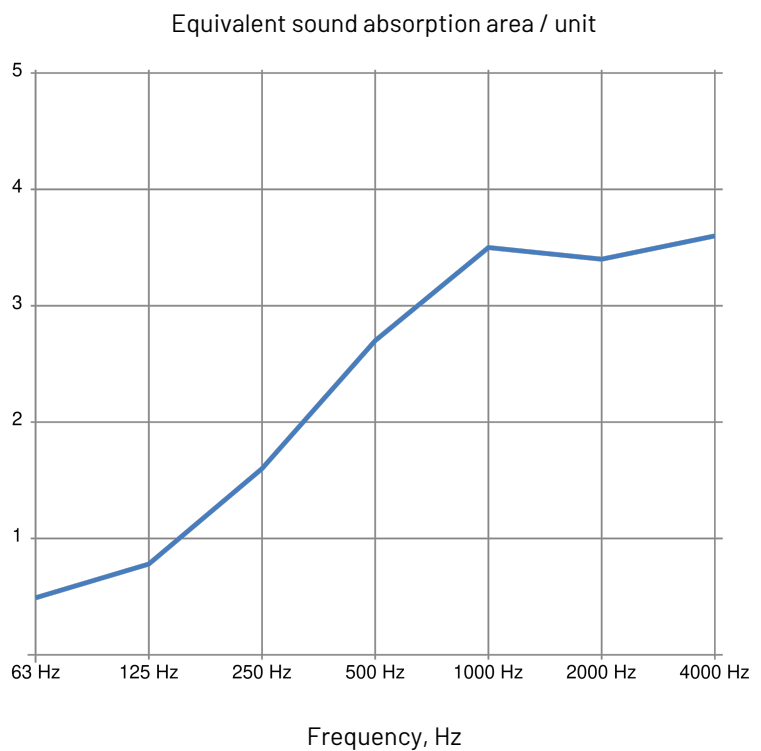

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M21	2021-10-29






SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Clamp wall round 60/80		
Size [mm]:	w = 800	h = 0	d = 57

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.02
125	0.11
250	0.42
500	0.8
1000	0.82
2000	0.69
4000	0.63
N₁₀ = 15.9	

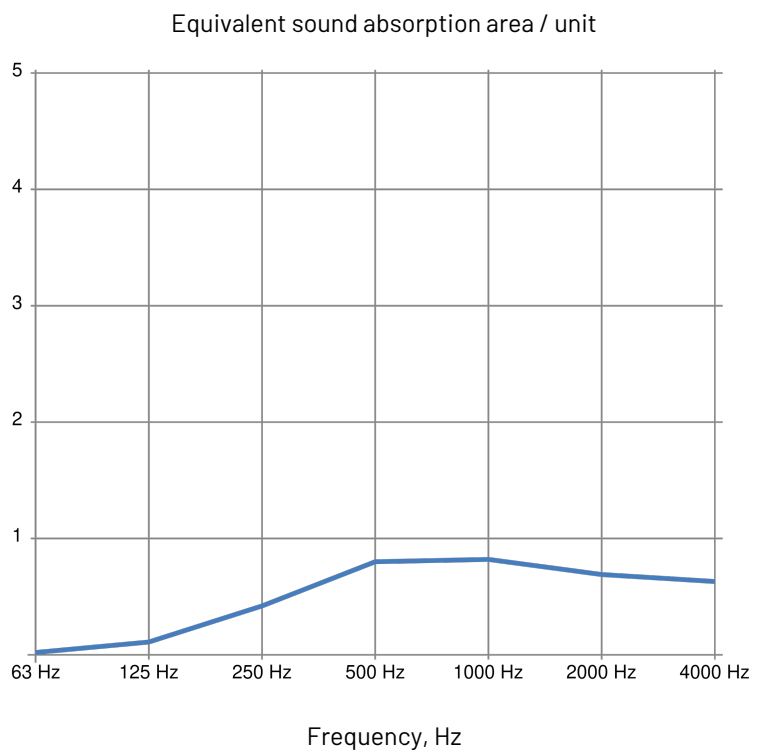

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M18	2021-10-29






SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189


Client:	Decibel AB		
Object:	Clamp wall round 60/80		
Size [mm]:	w = 600	h = 0	d = 57

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.02
125	0.06
250	0.2
500	0.5
1000	0.5
2000	0.42
4000	0.38
N₁₀ = 26.3	

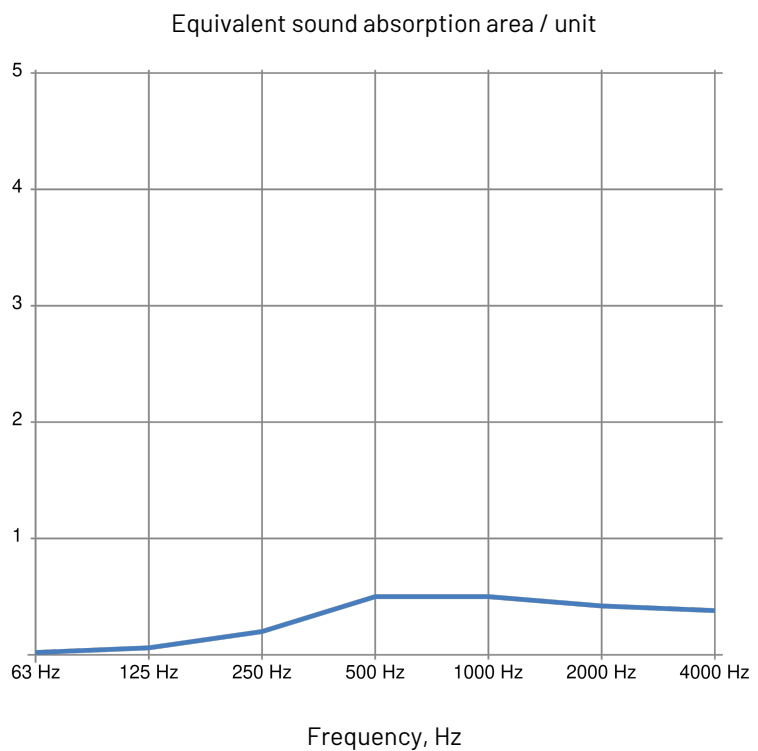

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M17	2021-10-29






SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189


Client:	Decibel AB		
Object:	Clamp wall square 60/80		
Size [mm]:	w = 600	h = 600	d = 57

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.2
125	0.09
250	0.27
500	0.51
1000	0.54
2000	0.49
4000	0.443
N₁₀ = 22.6	

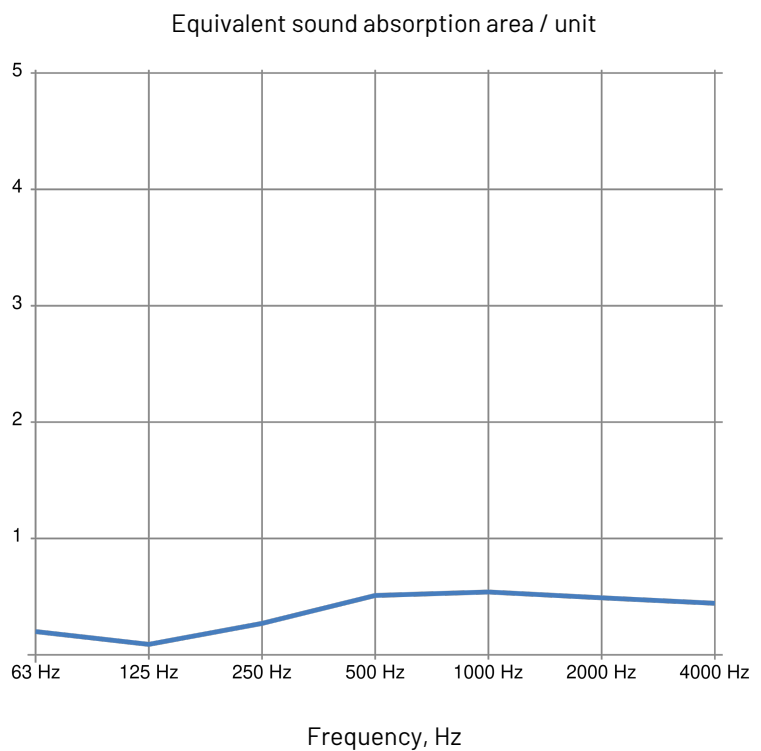

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M15	2021-10-29






SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Decibel AB		
Object:	Clamp wall square 60/80		
Size [mm]:	w = 800	h = 800	d = 57

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.04
125	0.16
250	0.54
500	0.87
1000	0.85
2000	0.83
4000	0.73
N₁₀ = 13.7	

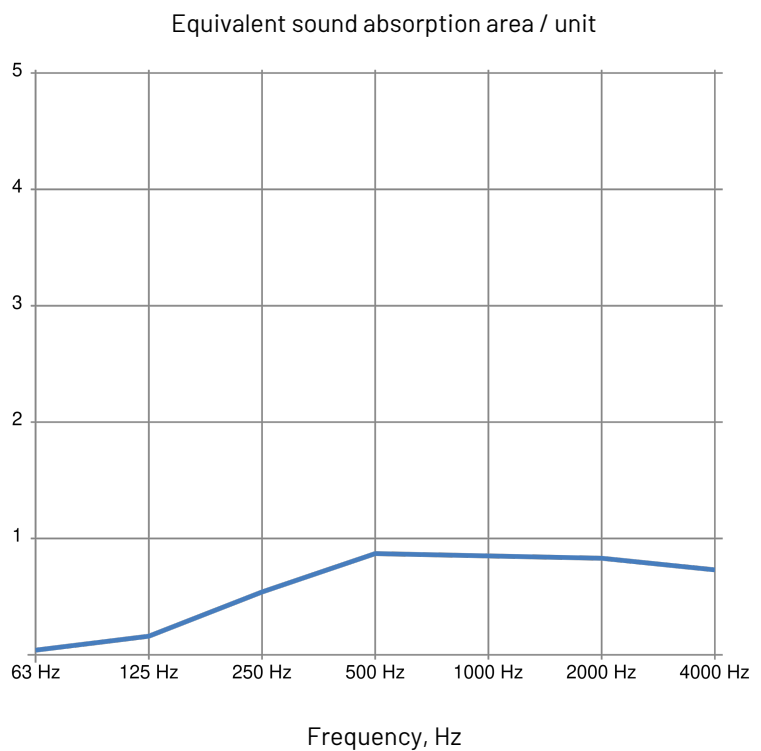

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 21-738-M16	2021-10-29

